


High Power LED Search Light T2

Wiring installation

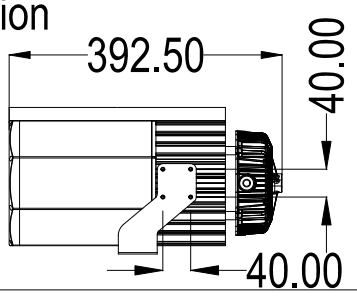


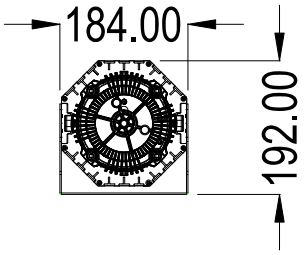


M6 mounting screw

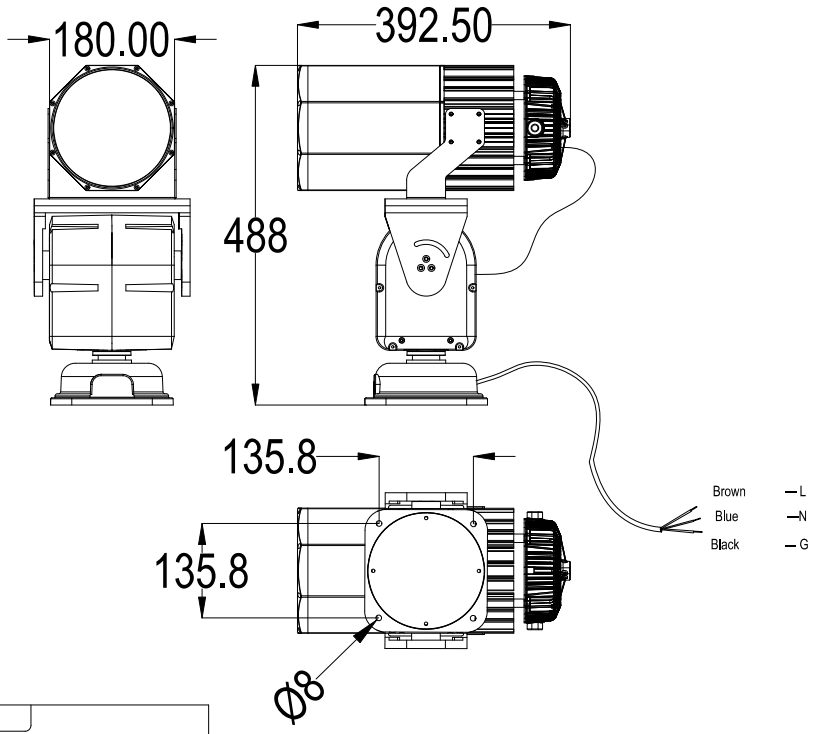


Reference height

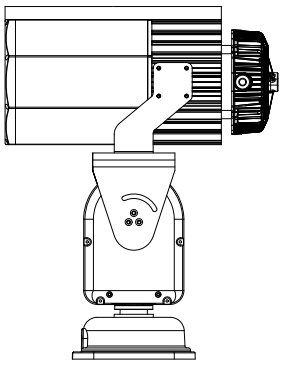

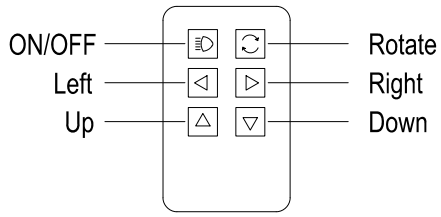


Cable Connection



6245IEC57 3X1.5mm2

Brown	L
Blue	N
Black	G





1.The luminaire shall be installed by a qualified electrician and wired in accordance with the latest IEE electrical regulations or the national requirements.
2. Do not switch on before complete installation.
3. Ta:-40~55°C
4. If the external flexible cable or cord of this luminaire is damaged, it shall be exclusively replaced by the manufacturer or his service agent or a similar qualified person in order to avoid a hazard.
5. The light source contained in this luminaire shall only be replaced by the manufacturer or his service agent or a similar qualified person.
6. Terminal block not included. Installation may require advice from a quaerson
The terminal block shall conform to IEC 60598-2-1
Rated voltage of terminal block: 100-220V/3-1.4A
Rated connecting capacity: Suitable for wire with cross-sectional area of 1.5 sq.mm
7. The wiring connection shall be done with IP66connection box(or higher IP rating)

22
PAP

Ed:2026/04 V1