


Installation Instruction

Dimension

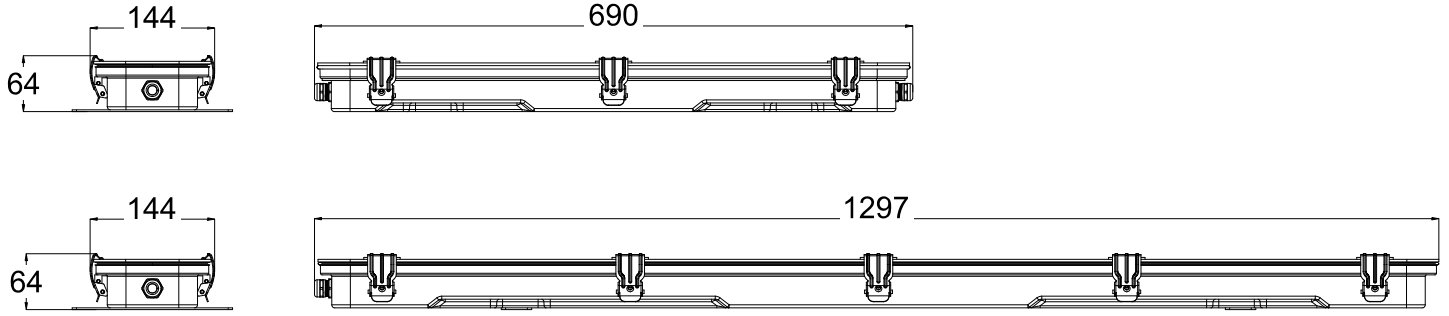


Surface installation



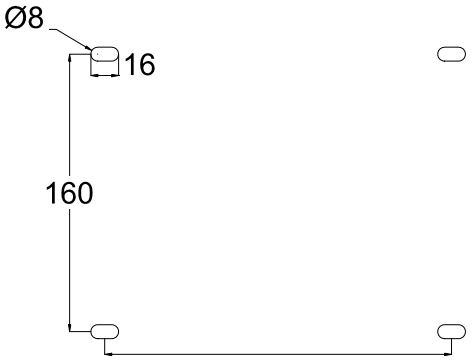


L	L10 H
300mm	700mm
1200mm	1600mm


Drilling hole position

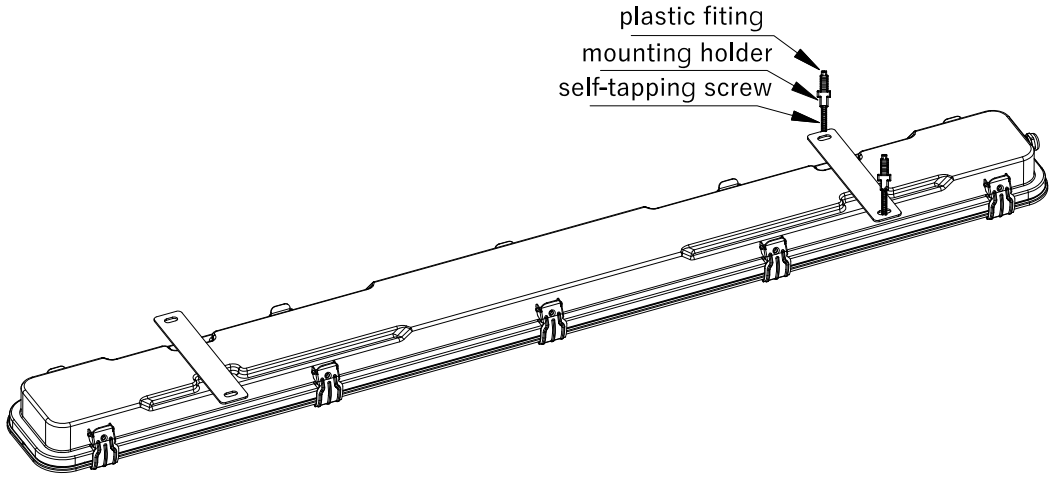


Ed:2026/10 V0


Emergency

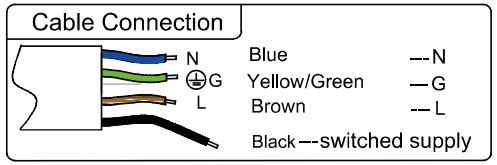

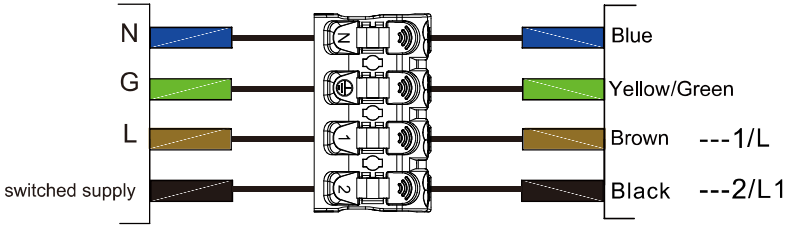



Dimming

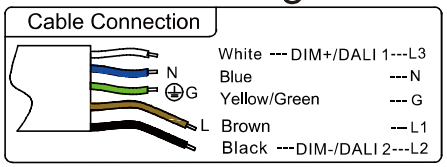


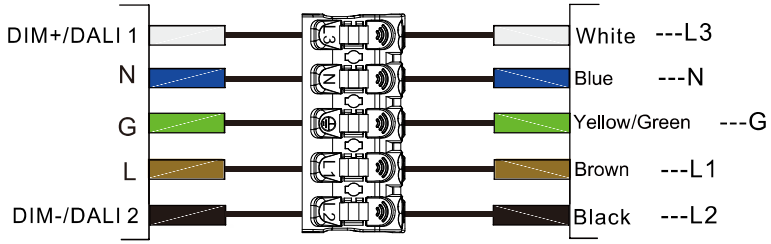


Emergency plus dimming

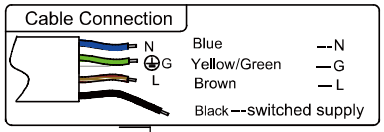





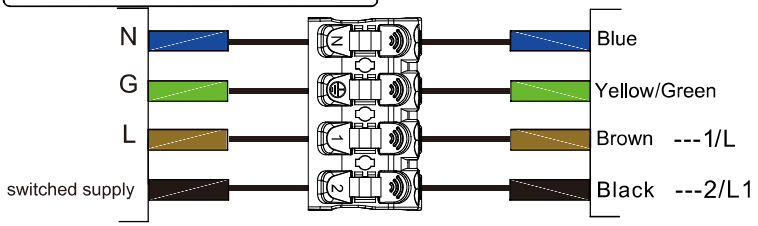



Ordinary and Induction

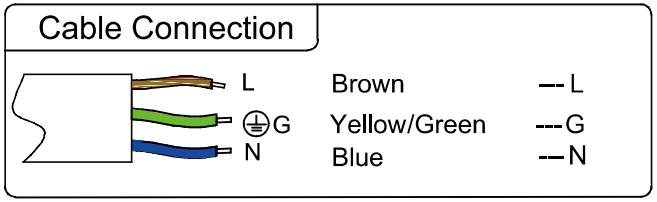

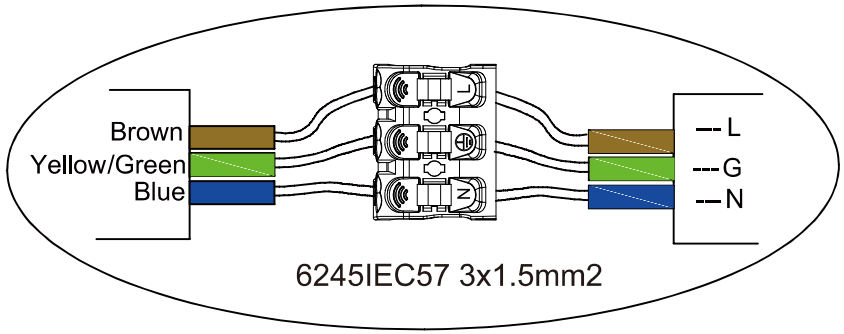

1.The luminaire shall be installed by a qualified electrician and wired in accordance with the latest IEE electrical regulations or the national requiremnts.
2.Do not switch on before complete installation.
3.Indoor use only at ta25℃
4.The external fiexible cable or cord of this luminaire cannot be replaced; if the cord is damaged,the luminaire shall be destroyed.
5.The light source of this luminaire is not replaceable;when the light source reaches is end of life the whole luminaire shall be replaced.

22
PAP

Ed:2026/10 V0